

Index

Low Temperature Field Test	2
Outdoor Field Test.....	5


Low Temperature Field Test

Fridge: Place in Fridge at 2019-Sep


Interval: 5minutes




Screen Shot at 2020-04-09

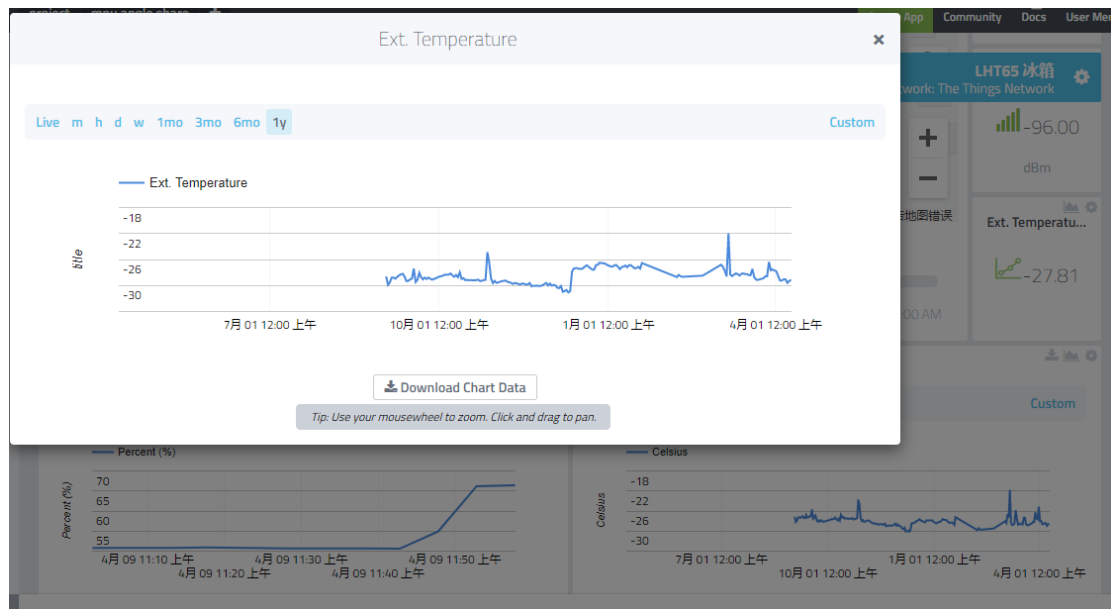


Screen Shot at 2020-04-28

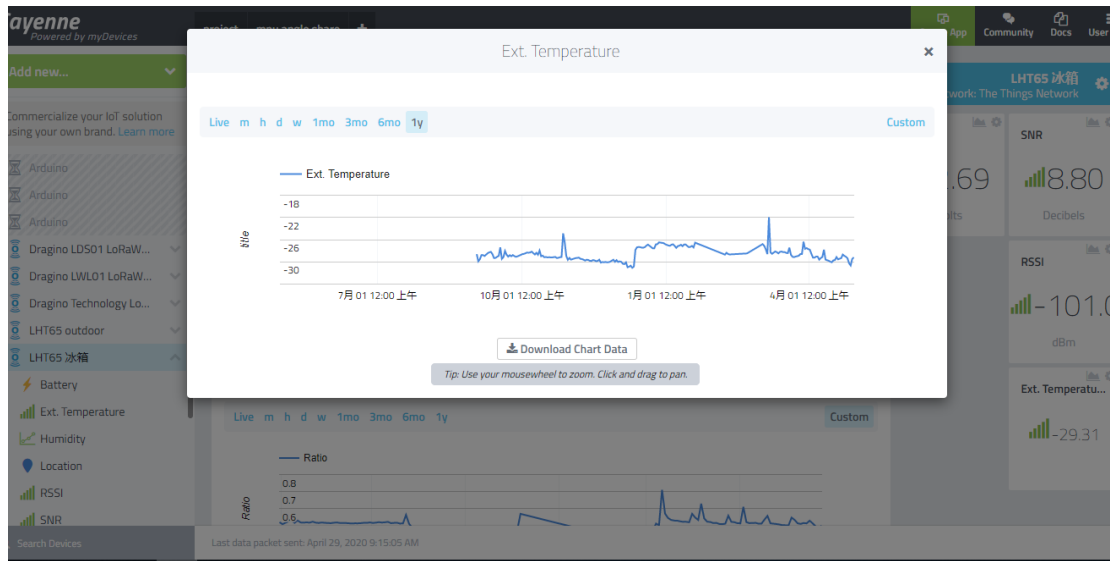

Screen Shot at 2020-05-20

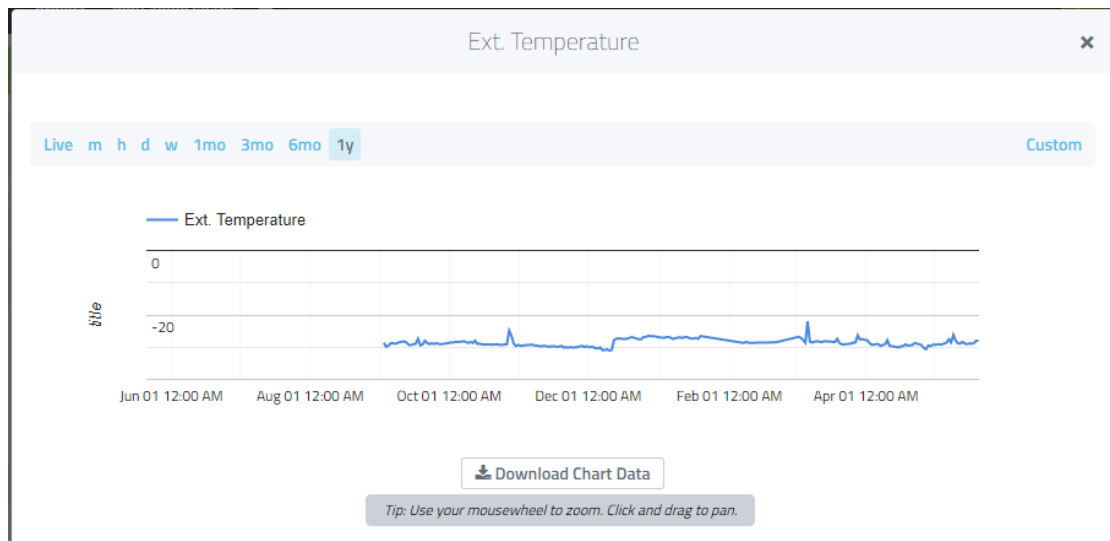


Screen Shot at 2020-05-20

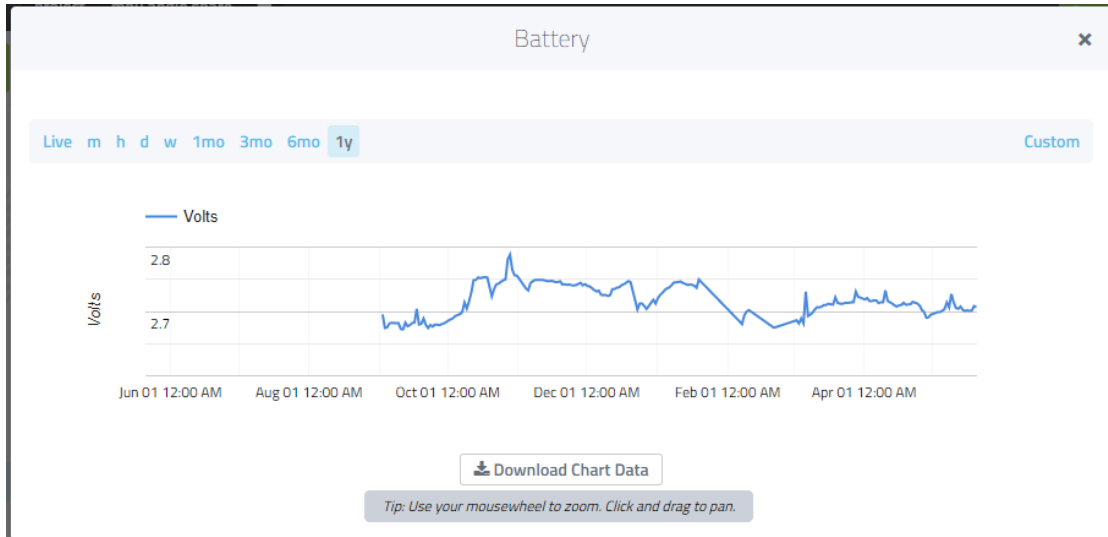

Outdoor Field Test

Outdoor: Place outdoor on air conditioner at 2019-Nov
Interval: 10 minutes

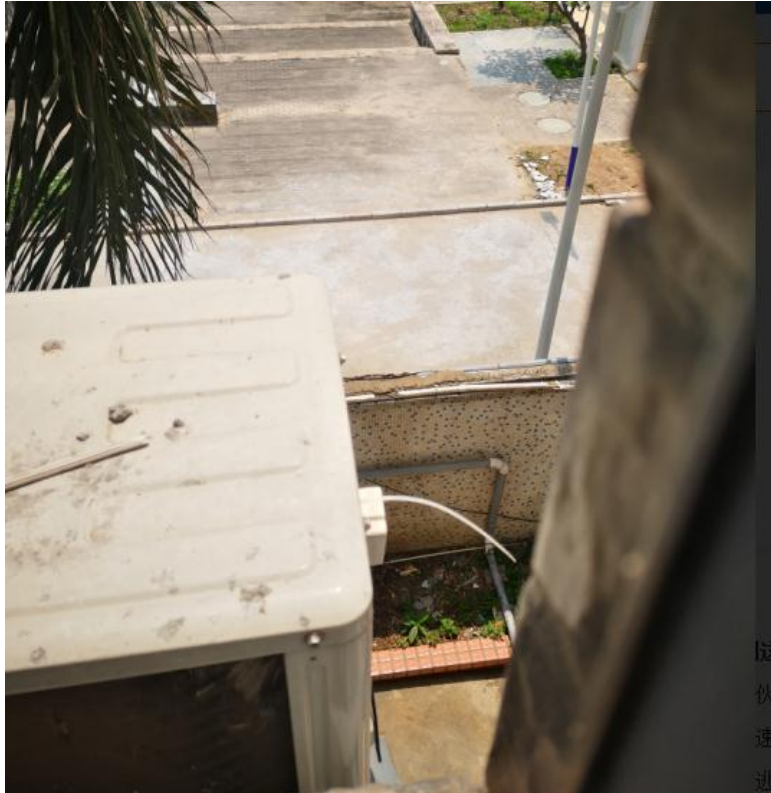


Screen Shot at 2020-04-09



Screen Shot at 2020-04-28



Screen Shot at 2020-05-20

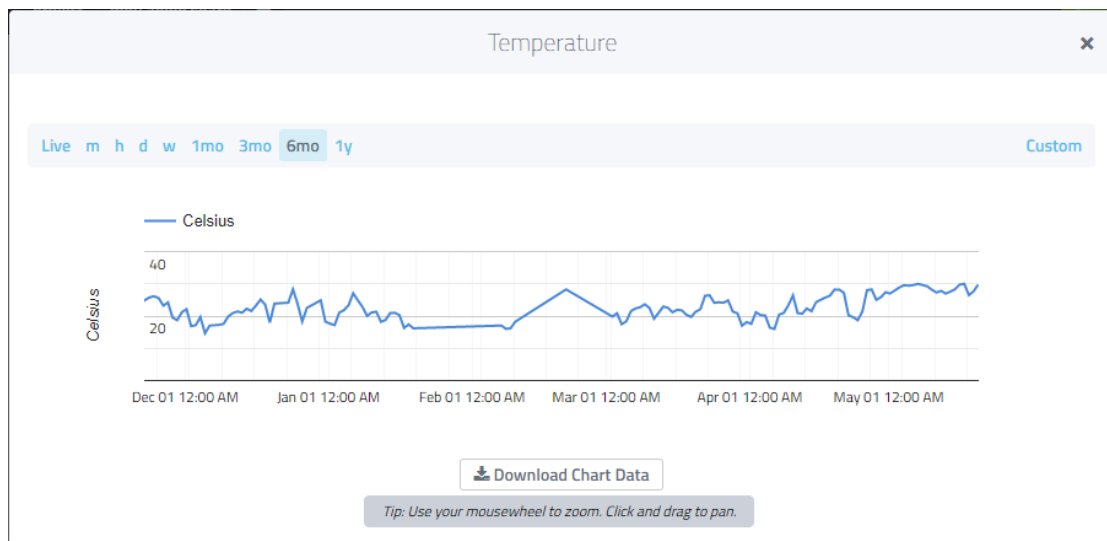

Screen Shot at 2020-05-20

